

Federal regulations require that *“In designating uses of a water body and the appropriate criteria for those uses, the State shall take into consideration the water quality standards of downstream waters and shall ensure that its water quality standards provide for the attainment and maintenance of the water quality standards of downstream waters.”* (40 CFR 131.10(b)).

Part A: Capitol Lake

The Budd Inlet TMDL will establish allocations to meet water quality standards in the marine waters of Budd Inlet. The TMDL will not focus on meeting standards in Capitol Lake or the lower Deschutes River. However, load allocations will be established for the lake and the river to ensure standards within the inlet are met.


Capitol Lake and the Deschutes River are both upstream of Budd Inlet and therefore need not be considered at this time. In the case that Capitol Lake remains and is not converted to an estuary, a separate TMDL will be completed for the lake and the lower Deschutes.

Ecology decided to write the TMDL only for marine waters because it is not useful to write a Capitol Lake TMDL if Capitol Lake reverts to an estuary. The only modeling scenarios to date which meet water quality standards convert the lake back to an estuary.


Part B: Puget Sound

In the case of Budd Inlet, the term *downstream* applies to the neighboring inlets within Puget Sound. The Budd Inlet TMDL will determine an aggregated allocation for external sources outside of Budd Inlet and a later TMDL or TMDL equivalent will determine WLA for specific permittees within the greater Puget Sound Region. However, the Budd Inlet TMDL *does* need to ensure that internal Budd Inlet allocations do not have a negative impact on the greater Puget Sound.

The figure below shows dissolved oxygen conditions in Budd Inlet under natural and existing conditions. The northern most grid cells are those that come into direct contact with the greater Puget Sound. As shown, the dissolved oxygen in these cells remains similar under natural and existing conditions and there is no violation of water quality standards.

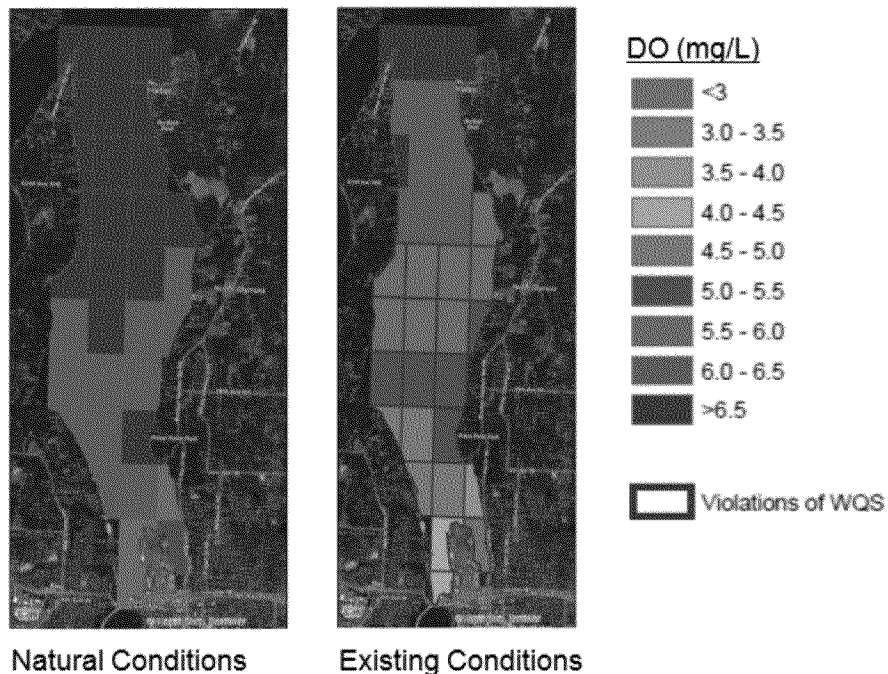

The figure below depicts impacts of four source categories on model grid cells within Budd Inlet under existing conditions. Cells 10, 11, and 12, the boundary cells, are indicated in yellow. As shown, under current conditions, oxygen depletion in these cells occurs only as a result of external pollution from outside of Budd Inlet and from Capitol Lake.

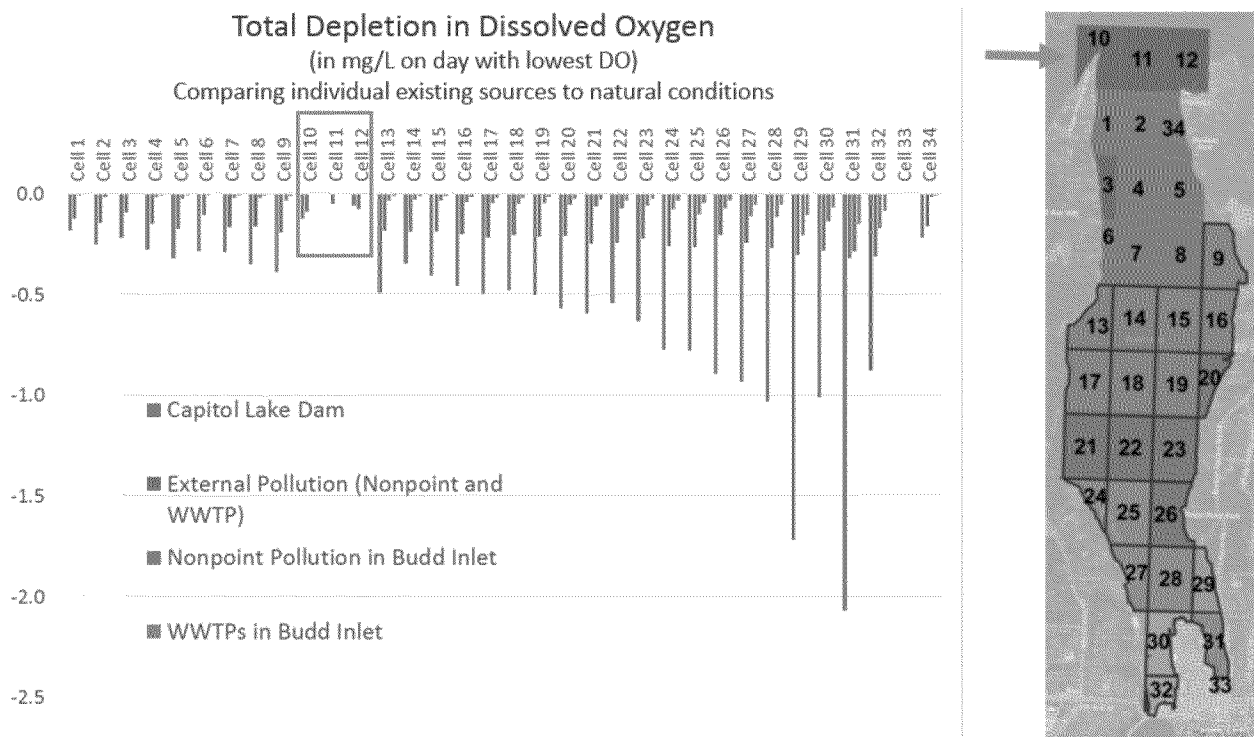

The table below indicates the value of dissolved oxygen depletion occurring in each of the boundary cells as a result of each of the four source groups.

Total Depletion in Dissolved Oxygen (current conditions, in mg/L on day with lowest DO)

	Cell 10	Cell 11	Cell 12
Capitol Lake Dam	-0.12	No Impact	-0.00
External Pollution	-0.03	-0.03	-0.01
Budd Inlet Nonpoint Pollution	No impact	No Impact	No Impact
Budd Inlet Budd Inlet	No impact	No Impact	No Impact

**No Impact indicates zero negative impact (0.0).*

The minimal impact that Budd Inlet sources have on cells 10, 11, and 12 indicates that impacts on any neighboring areas would also be minimal and not lead to water quality violations. The TMDL will assign allocations to the Capitol Lake dam and all other Budd Inlet sources further reducing these impacts.

Options for further addressing impacts on Puget Sound

If more explanation regarding Budd Inlet's minimal impacts to neighboring regions of Puget Sound is needed, two options have been identified.

Option 1: A narrative explanation of bathometric and oceanic conditions could be provided to explain the why dissolved oxygen depletion from Budd Inlet is not likely to impact areas outside of the inlet.

Option 2: The Salish Sea model could be used to show modeled oxygen levels for the entire sound. In this case we could remove the external pollution sources and determine the impact of only Capitol Lake Dam, Budd Inlet nonpoint pollution, and WWTPs in Budd Inlet.

The options described above would require additional staff from outside of the water quality program. However, they are feasible and fit within the scope of the project, so can be utilized if needed.